
## 2-Colour Display High Precision **Digital Pressure Switch**





The settings of the master pressure switch (source of copy) can be copied to the slave pressure switches.


Reduction in setting work
 Prevention of mistakes in setting

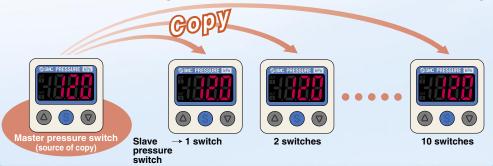

#### Easy handling!



Raised rubber switch buttons for easy and comfortable operation

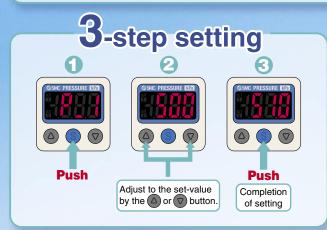

## 2-colour display

See abnormal values at a glance.










Series ZSE40A(F)/ISE40A




#### **Piping Variations**


# R1/8, NPT1/8 M5 x 0.8 Rc1/8, G1/8 Active Active

#### **Space-saving**




#### **Mounting Variations**

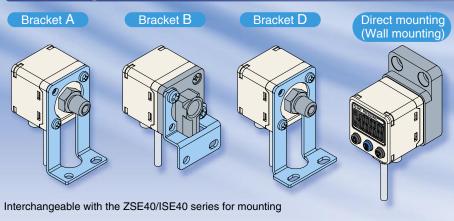



#### **Series**

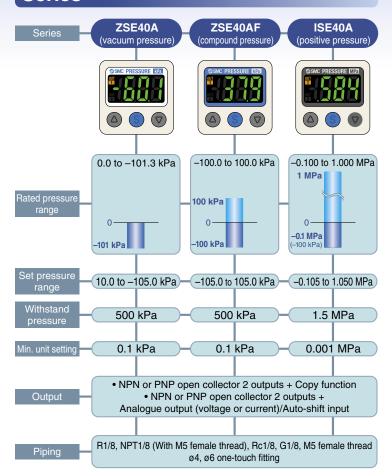

#### Secret code setting function-----

A function to prevent operation by anyone other than the designated operator while the keys are locked.



An optional 3-digit value is entered.

 $\ast$  The set-value can be checked while the keys are locked.

#### Power-saving function-----

The display can be turned off to save the power consumption. (Power consumption reduced by max. **20%**)



The value disappears and decimal points start flashing.

#### Resolution conversion function .....

The flickering on the display can be eliminated.



(Only the displayed value is changed, and there is no effect on the accuracy.)


#### MPa/kPa switching function·····

The indication unit for vacuum, compound pressure and positive pressure can be integrated into either MPa or kPa.





## Digital Pressure Switch Series ZSE40A(F)/ISE40A

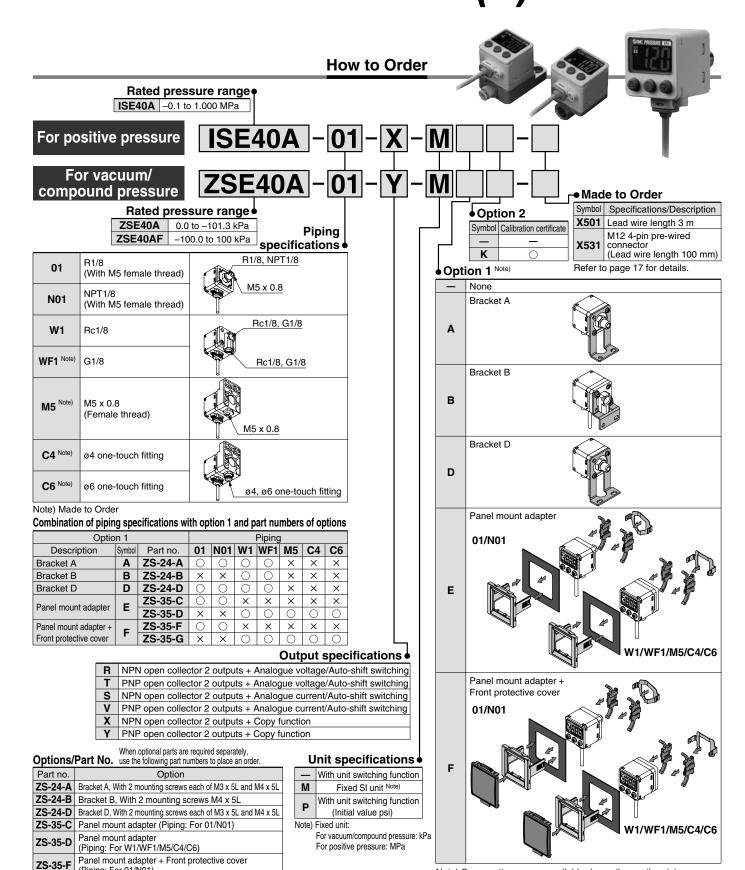

Note) Some options are unavailable depending on the piping specifications. Refer to "Combination of piping specifications with option 1 and part numbers of options".



(Piping: For 01/N01)

Panel mount adapter + Front protective cover

(Piping: For W1/WF1/M5/C4/C6)

#### **Specifications**

Model		ZSE40A (vacuum pressure)	ZSE40AF (compound pressure) ISE40A (positive press					
Rated pre	essure rang	je	0.0 to -101.3 kPa	-100.0 to 100.0 kPa	-0.100 to 1.000 MPa			
Display/S	et pressur	e range	10.0 to -105.0 kPa	-105.0 to 105.0 kPa	-0.105 to 1.050 MPa			
Withstand	d pressure		500 kPa	500 kPa	1.5 MPa			
Display/M	linimum ur	nit setting	0.1 kPa	0.1 kPa	0.001 MPa			
Applicabl	le fluid		Air, Non-corrosive gas, Non-flammable gas					
Power su	pply voltag	je	12 to 24 VDC ±10%, Ripp	12 to 24 VDC ±10%, Ripple (p-p) 10% or less (with power supply polarity protection)				
Current c	onsumptio	n		45 mA or less				
Switch ou	utput		NPN or F	PNP open collector 2 outputs (Se	electable)			
	Maximum	load current		80 mA				
	Maximum	applied voltage		28 V (at NPN output)				
	Residual	voltage		1 V or less				
	Response		2.5 ms (with anti-	chattering function: 20, 100, 500	), 1000, 2000 ms)			
	Short circ	uit protection		Yes				
Repeat ac				±0.2% F.S. ±1 digit				
Hysteresis	Hysteresi			Variable (0 or above) Note 1)				
,0.0.00.0	Window o	comparator mode						
I .	Note 2	Output voltage	1 to 5 V ±	0.6 to 5 V ±2.5% F.S.				
	Voltage	(Rated pressure range)	±1% F.S. or less					
	output	Linearity	$\pm$ 1% F.S. or less Approx. 1 k $\Omega$					
Analogue		Output impedance Output current						
output	Note 3	(Rated pressure range)	4 to 20 mA	2.4 to 20 mA ±2.5% F.S.				
	Current	Linearity	±1% F.S. or less					
	output		Maximum load impedance: 300 $\Omega$ (Power supply voltage 12 V)					
		Load impedance	Minimum load	bly voltage 24 V)				
Auto-shif	t innut		Minimum load impedance: $50 \Omega$ Non-voltage input (Reed or Solid state), Low level: $0.4 \text{ V}$ or less, $5 \text{ ms}$ or longer input					
Display	· iiiput		3 1/2-digit, 7-segment, 2-colour LCD (Red/Green)					
Display a	ccuracy		±2% F.S. ±1 digit (Ambient temperature of 25 ±3°C)					
Indicator			Lights up when output is turned ON. OUT1, OUT2: Orange					
		osure		IP65				
	Oper	ating temperature range	Operating: -5 to 50°C, Stored: -10 to 60°C (No freezing or condensation)					
		ating humidity range	Operating/Stored: 35 to 85% RH (No condensation)					
Environm		stand voltage	1000 VAC for 1 minute between live parts and case					
resistance	e Insul	ation resistance	50 MΩ or more	between live parts and case (at	500 VDC Mega)			
	Vibra	ition resistance	10 to 150 Hz at whichever is smaller of 1.5 mm amplitude or 20 m/s² acceleration, in X, Y, Z directions, for 2 hours each (De-energized)					
Impact resistance		ct resistance	100 m/s <sup>2</sup> in X, Y, Z directions, 3 times each (De-energized)					
Temperature characteristics			±2% F.S. (Based on 25°C)					
-	Lead wire		Oilproof heavy-duty vinyl cable  ø3.5, 2 m Conductor area: 0.15 mm² (AWG26) Insulator O.D.: 0.95 mm					
Standarda								
Standards			CE marking, UL (CSA), RoHS compliance					

Note 1) If the applied voltage fluctuates around the set-value, the hysteresis must be set to a value more than the fluctuating width, otherwise chattering will occur.

#### **Piping Specifications**


Part no.		01	N01	W1	WF1	M5	C4	C6
Port size		R1/8 (With M5 female thread)	NPT1/8 (With M5 female thread)	Rc1/8	G1/8	M5 x 0.8 female thread	ø4 one-touch fitting	ø6 one-touch fitting
Material	Sensor pressure receiving area	Silicon						
of parts in contact with fluid	Piping port	,	ess nickel plated) HNBR	d) ZDC2 ZDC2, POM, Stainl C3604 (Electroless O-ring: HNBR		ess nickel plated)		
Weight		78 g	79 g	97	' g	104 g	10	1 g




Note 2) When the analogue voltage output is selected, the analogue current output cannot be selected. Note 3) When the analogue current output is selected, the analogue voltage output cannot be selected.

#### **Analogue Output**

#### Voltage output



#### **Current output**



Range	Rated pressure range	Α	В	С
For vacuum pressure	0.0 to -101.3 kPa	10.1 kPa	0	–101.3 kPa
For compound pressure	-100.0 to 100.0 kPa	_	–100.0 kPa	100.0 kPa
For positive pressure	-0.100 to 1.000 MPa	-0.100 MPa	0	1.000 MPa

#### **Descriptions**

#### Output (OUT1) display (Orange)

Lights up when OUT1 is turned ON.

#### Output (OUT2) display (Orange)

Lights up when OUT2 is turned ON.

#### $\triangle$ button

Use this button to select the mode or increase the ON/OFF set-value. It is also used for switching to the peak display mode.



#### LCD

Displays the current pressure, set mode, selected display unit, and error code. Always use red or green display; or switch between green and red according to the output. Four different display settings are available.

#### SET button

Use this button to change the mode or confirm the set-value.


#### $\nabla$ button

Use this button to select the mode or decrease the ON/OFF set-value. It is also used for switching to the bottom display mode.




#### **Internal Circuits and Wiring Examples**

#### -R NPN (2 outputs) + Analogue voltage output




Max. 28 V, 80 mA Residual voltage 1 V or less

#### -S NPN (2 outputs) + Analogue current output




Max. 28 V, 80 mA Residual voltage 1 V or less

#### -R/-S NPN (2 outputs) + Auto-shift input




Max. 28 V, 80 mA Residual voltage 1 V or less

#### -T PNP (2 outputs) + Analogue voltage output




Max. 80 mA Residual voltage 1 V or less

#### -V PNP (2 outputs) + Analogue current output




Max. 80 mA Residual voltage 1 V or less

-T/-V PNP (2 outputs) + Auto-shift input




Max. 80 mA Residual voltage 1 V or less

#### -X NPN (2 outputs) + Copy function



Max. 28 V, 80 mA Residual voltage 1 V or less

-Y PNP (2 outputs) + Copy function





Max. 80 mA Residual voltage 1 V or less


#### **Dimensions**


#### ZSE40A(F)/ISE40A-01

-N0<sup>-</sup>













#### ZSE40A(F)/ISE40A-W1 -WF1

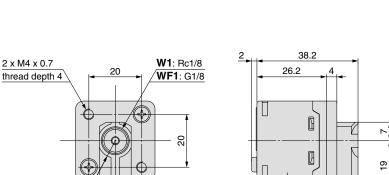








#### **Dimensions**

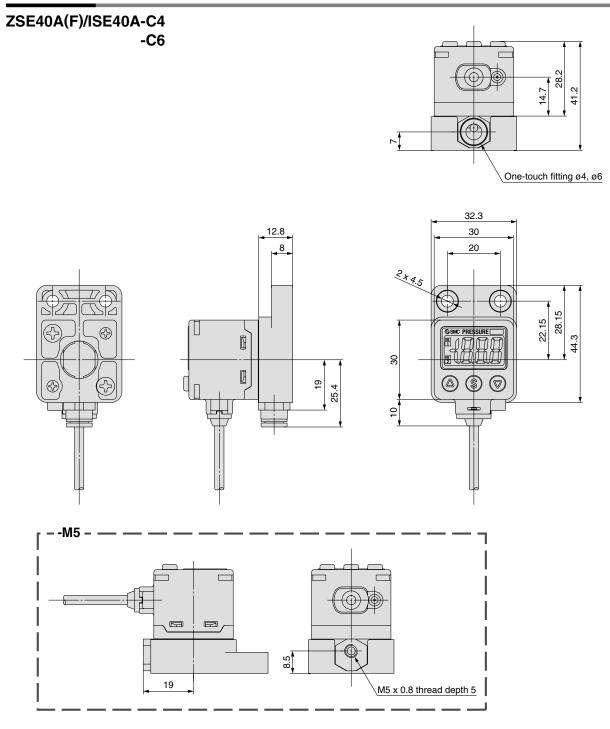



#### **Dimensions**


**ZSE40A(F)/ISE40A-01-**□**-**□**A**□


-N01-□-□A□

With bracket












**ZSE40A(F)/ISE40A-01-**□**-**□**D**□


-N01-□-□D□

With bracket











#### **Dimensions**


ZSE40A(F)/ISE40A-W1-□-□A□

-WF1-□-□A□

With bracket






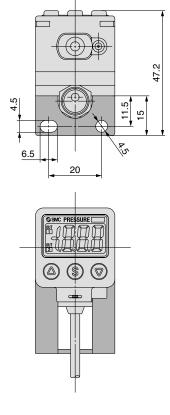



ZSE40A(F)/ISE40A-W1-□-□B□

-WF1-□-□B□

With bracket





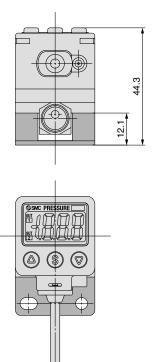



#### **Dimensions**


ZSE40A(F)/ISE40A-W1-□-□D□


-WF1-□-□D□

With bracket











#### **Dimensions**

**ZSE40A(F)/ISE40A-01-**□-□**E**□

-N01-□-□E□

Panel mounting

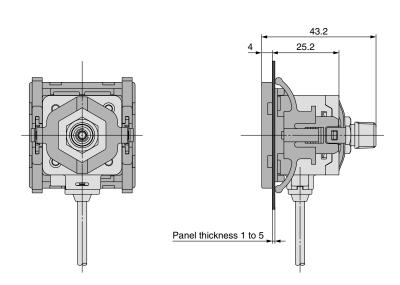


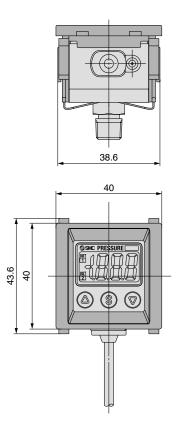



**ZSE40A(F)/ISE40A-01-**□-□**F**□

-N01-□-□F□

Panel mounting + Front protective cover

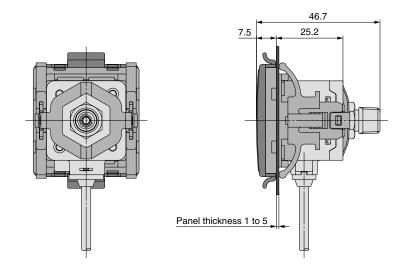







#### **Dimensions**


#### ZSE40A(F)/ISE40A-W1-□-□E□

-WF1-□-□E□

Panel mounting



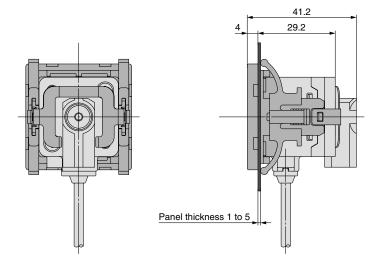






#### ZSE40A(F)/ISE40A-W1-□-□F□

-WF1-□-□F□

Panel mounting + Front protective cover



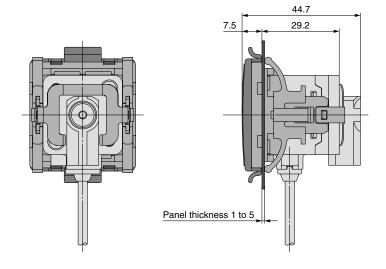







#### **Dimensions**


ZSE40A(F)/ISE40A-C4-□E□


-C6-□E□

Panel mounting












ZSE40A(F)/ISE40A-C4-□F□


-C6-□F□

Panel mounting + Front protective cover










#### **Dimensions**

## Panel fitting dimensions | SWC PRESSURE | SWC PRES

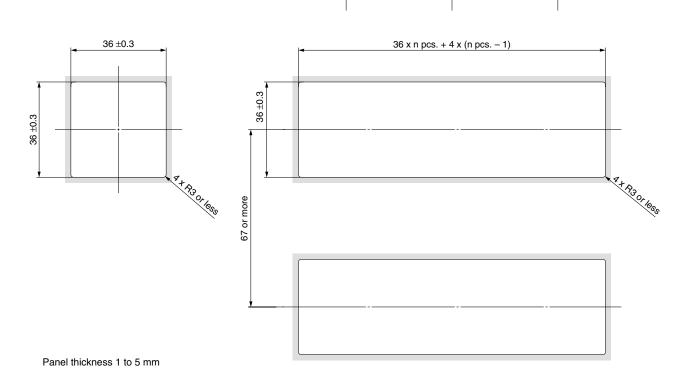

Note) This is the minimum value for the piping method 01 or N01.

Take the piping material and tubing into account for design. When the corner is to have radius, it must be R3 or less.




#### **Function Details**


#### A Copy function (F97)

The settings of the master pressure switch can be copied to several slave pressure switches.

This can reduce the labour for setting and prevent the entry of incorrect set-values.

The set-value can be copied to up to 10 switches simultaneously. (Maximum communication distance 4 m)



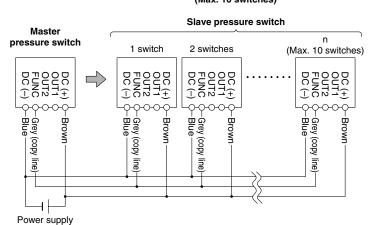


- 1) Wire as shown in the left figure.
- 2) Select the slave switch which is to be the master, and change it into a master using the buttons. (In the default setting, all switches are set as slaves.)
- 3) Press the S button of the master switch to start copying.

#### B Auto-preset function (F 4)

Auto-preset function, when selected in the initial setting, calculates and stores the set-value from the measured pressure. The optimum set-value is determined automatically by repeating vacuum and break with the target work piece several times.

#### **Suction Verification**




#### Formula for Obtaining the Set-Value

P_1 or P_2	H_1 or H_2
$P_1 (P_2) = A - (A-B)/4$ $n_1 (n_2) = B + (A-B)/4$	H_1 (H_2) = (A-B)/2

#### C Display calibration function (F 6)

Fine adjustment of the indicated value of the pressure sensor can be made within the range of  $\pm 5\%$  of the read value. (The scattering of the indicated value can be eliminated.)

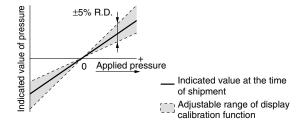

Note) When the display calibration function is used, the set pressure value may change  $\pm 1$  digit.

#### D Peak and bottom display function

This function constantly detects and updates the maximum (minimum) value and allows to hold the maximum (minimum) pressure value.

When the ⓐ v buttons are simultaneously pressed for 1 second or longer, while "holding", the hold value will be reset.

#### E Key lock function

This function prevents incorrect operations such as accidentally changing the set-value.

#### F Zero-clear function

This function clears and resets the zero value on the display of measured pressure.

For the pressure switch with analogue output, the analogue output shifts according to the indication. The indicated value can be adjusted within  $\pm 7\%$  F.S. of the pressure when ex-factory. (ZSE40AF (for compound pressure)  $\pm 3.5\%$  F.S.)



The  $F\square$  in brackets shows the function code number. Refer to the Operation Manual for the details of operation procedures and

#### **G** Error indication function

Error name	Error code	Description	Remedy	
Overcurrent	Er 1	Load current of switch output (OUT1) exceeds 80 mA.	Turn the power off and remove the output factor for	
error	ErZ	Load current of switch output (OUT2) exceeds 80 mA.	the overcurrent. Then, turn the power on.	
Residual pressure error	Er3	During zero-clear operation, pressure over $\pm 7\%$ F.S. is applied. (ZSE40AF (compound) $\pm 3.5\%$ F.S.) After 1 second, the mode will reset to measurement mode. $\pm 1\%$ F.S. of the zero-clear range varies between individual products.	Perform zero-clear operation again after restoring the applied pressure to an atmospheric pressure condition.	
Applied	HHH	Supply pressure exceeds the maximum set pressure.	Reset applied pressure to a level within the set pressure range.	
pressure error	LLL	Supply pressure is below the minimum set pressure.		
Auto-shift error	ac I a sum a		The controller does not respond to the auto-shift signal. Check the equipment and machinery for this point.	
System error	E-0 E-4 E-5 E-7 E-8	Internal data error	Turn the power off and turn it on again. If the failure cannot be solved, ask SMC for repair.	

If the above remedy cannot recover the operation, ask SMC for repair.


#### H Anti-chattering function (F 3)

A large bore cylinder or ejector consumes a large volume of air in operation and may experience a temporary drop in the supply pressure. This function prevents detection of such temporary drops in the supply pressure as an error.

Available response time settings
20 ms, 100 ms, 500 ms, 1000 ms, 2000 ms

#### <Principle>

This function averages pressure values measured during the response time set by the user and then compares the average pressure value with the pressure set point value to output the result on the switch.

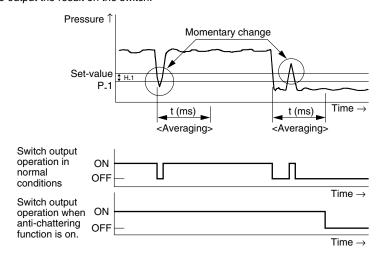

#### Display unit switching function (F 0)

Display units can be switched with this function.

Display unit	۶	'R	5F	ьял	P5,	ıπΗ	ññX
Minimum unit setting	kPa	MPa Note)	kgf/cm <sup>2</sup>	bar	psi	inHg	mmHg
ZSE40A (vacuum pressure)	0.1	0.001	0.001	0.001	0.01	0.1	1
ZSE40AF (compound pressure)	0.1	0.001	0.001	0.001	0.02	0.1	1
ISE40A (positive pressure)	1	0.001	0.01	0.01	0.1		

Note) The ZSE40A (vacuum pressure) and ZSE40AF (compound pressure) will have different setting and display resolution when the unit is set to MPa.



#### **Function Details**

The  $F\square$  in ( ) shows the function code number. Refer to the Operation Manual for the details of operation procedures and function codes.

#### J Power-saving mode (F80)

Power-saving mode can be selected.

It shifts to the power-saving mode without button operation for 30 seconds. It is set to the normal mode (Power-saving mode is OFF.) when ex-factory. (Decimal points and operation indicator light (only when the switch output is turned ON) blink in the power-saving mode.)


#### K Secret code setting (F81)

It can be set whether secret code input is required or not when key is locked. It is set to input no secret code when ex-factory.

#### Auto-shift function (F 5)

When there are large fluctuations in the supply pressure, the switch may fail to operate correctly. The auto-shift function compensates such supply pressure fluctuations. It measures the pressure at the time of auto-shift signal input and uses it as the reference pressure to correct the set-value on the switch.

#### Set-value correction by auto-shift function

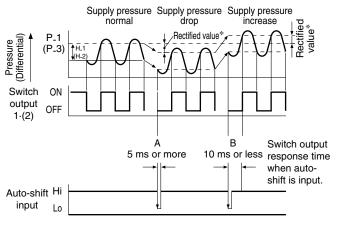

#### \* Rectified value

When the auto-shift is selected, "ooo" will be displayed for about 1 second, and the pressure value at that point will be saved as a rectified value " $\mathcal{L}_-5$ ". Based on the saved rectified values, the set-value Note) of " $\mathcal{P}_-1$ ", " $\mathcal{H}_-1$ ", " $\mathcal{P}_-2$ ", and " $\mathcal{H}_-2$ " will likewise be rectified.

Note) When an output is reversed, "n\_ 1", "H\_ 1", "n\_2", "H\_2" will be rectified.

#### Possible Set Range for Auto-Shift Input

	Regulating pressure range	Possible set range
Compound pressure	-105.0 to 105.0 kPa	-210 to 210 kPa
Vacuum pressure	10.0 to -105.0 kPa	115.0 to -115.0 kPa
Positive pressure	-0.105 to 1.050 MPa	-1.155 to 1.155 MPa

#### Auto-shift zero

The basic function of auto-shift zero is the same as the function for auto-shift. Also, it corrects values on the display, based on a pressure value of " " [] when the auto-shift is selected.



## Series ZSE40A(F)/ISE40A **Made to Order**




Please contact SMC for detailed dimensions, specifications, and lead times.

## Lead wire length 3 m

Symbol -X501

\* Refer to How to Order on page 1 for standard specifications.


It has a lead wire extended to 3 meters.

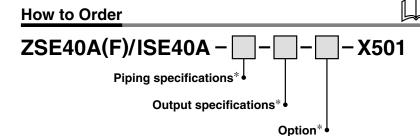

Symbol

2 M12 4-pin pre-wired connector (Lead wire length 100 mm)


How to Order




Output specifications

X: NPN open collector 2 outputs

Y: PNP open collector 2 outputs

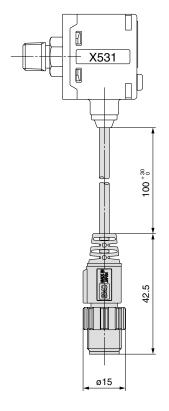

#### Pin arrangement





## Safety Instructions

These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of "Caution," "Warning" or "Danger." They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC)Nota 1), and other safety regulations.

Note 1) ISO 4414: Pneumatic fluid power – General rules relating to systems.

ISO 4413: Hydraulic fluid power – General rules relating to systems.

IEC 60204-1: Safety of machinery - Electrical equipment of machines. (Part 1: General requirements)

ISO 10218: Manipulating industrial robots - Safety.

Caution: Caution indicates a hazard with a low level of risk which, if not avoided, could result in minor or

moderate injury.

**⚠** Warning:

Warning indicates a hazard with a medium level of risk which, if not avoided, could result in death or

serious injury.

Danger

Danger indicates a hazard with a high level of risk which, if not avoided, will result in death or serious

injury.

#### **⚠** Warning

1. The compatibility of the product is the responsibility of the person who designs the equipment or decides its specifications.

Since the product specified here is used under various operating conditions, its compatibility with specific equipment must be decided by the person who designs the equipment or decides its specifications based on necessary analysis and test results. The expected performance and safety assurance of the equipment will be the responsibility of the person who has determined its compatibility with the product. This person should also continuously review all specifications of the product referring to its latest catalogue information, with a view to giving due consideration to any possibility of equipment failure when configuring the equipment.

2. Only personnel with appropriate training should operate machinery and equipment.

The product specified here may become unsafe if handled incorrectly. The assembly, operation and maintenance of machines or equipment including our products must be performed by an operator who is appropriately trained and experienced.

- 3. Do not service or attempt to remove product and machinery/equipment until safety is confirmed.
  - 1. The inspection and maintenance of machinery/equipment should only be performed after measures to prevent falling or runaway of the driven objects have been confirmed.
  - 2. When the product is to be removed, confirm that the safety measures as mentioned above are implemented and the power from any appropriate source is cut, and read and understand the specific product precautions of all relevant products carefully.
  - 3. Before machinery/equipment is restarted, take measures to prevent unexpected operation and malfunction.
- 4. Contact SMC beforehand and take special consideration of safety measures if the product is to be used in any of the following conditions.
  - 1. Conditions and environments outside of the given specifications, or use outdoors or in a place exposed to direct
  - 2. Installation on equipment in conjunction with atomic energy, railways, air navigation, space, shipping, vehicles, military, medical treatment, combustion and recreation, or equipment in contact with food and beverages, emergency stop circuits, clutch and brake circuits in press applications, safety equipment or other applications unsuitable for the standard specifications described in the product catalogue.
  - 3. An application which could have negative effects on people, property, or animals requiring special safety analysis.
  - 4. Use in an interlock circuit, which requires the provision of double interlock for possible failure by using a mechanical protective function, and periodical checks to confirm proper operation.





#### **A**Caution

1. The product is provided for use in manufacturing industries.

The product herein described is basically provided for peaceful use in manufacturing industries.

If considering using the product in other industries, consult SMC beforehand and exchange specifications or a contract if necessary.

If anything is unclear, contact your nearest sales branch.

#### Limited warranty and Disclaimer/Compliance Requirements

The product used is subject to the following "Limited warranty and Disclaimer" and "Compliance Requirements". Read and accept them before using the product.

#### **Limited warranty and Disclaimer**

- 1. The warranty period of the product is 1 year in service or 1.5 years after the product is delivered. Note 2) Also, the product may have specified durability, running distance or replacement parts. Please consult your nearest sales branch.
- 2. For any failure or damage reported within the warranty period which is clearly our responsibility, a replacement product or necessary parts will be provided.
  - This limited warranty applies only to our product independently, and not to any other damage incurred due to the failure of the product.
- 3. Prior to using SMC products, please read and understand the warranty terms and disclaimers noted in the specified catalogue for the particular products.

#### Note 2) Vacuum pads are excluded from this 1 year warranty.

A vacuum pad is a consumable part, so it is warranted for a year after it is delivered.

Also, even within the warranty period, the wear of a product due to the use of the vacuum pad or failure due to the deterioration of rubber material are not covered by the limited warranty.

#### **Compliance Requirements**

- 1. The use of SMC products with production equipment for the manufacture of weapons of mass destruction (WMD) or any other weapon is strictly prohibited.
- 2. The exports of SMC products or technology from one country to another are governed by the relevant security laws and regulations of the countries involved in the transaction. Prior to the shipment of a SMC product to another country, assure that all local rules governing that export are known and followed.



## Series ZSE40A(F)/ISE40A Specific Product Precautions 1

Be sure to read before handling.

Refer to back pages 1 and 2 for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) for Pressure Switches Precautions.

#### Handling

#### **⚠** Caution

- Do not drop, bump, or apply excessive impacts (100 m/s²) while handling. Although the body of the sensor may not be damaged, the internal parts of the sensor could be damaged and lead to a malfunction.
- The tensile strength of the cord is 49 N. Applying a greater pulling force on it can cause a malfunction.
   When handling, hold the body of the sensor—do not dangle it from the cord.
- 3. Do not exceed the screw-in torque of 7 to 9 N·m when connecting the pipe to the switch. Exceeding this torque may cause the switch to malfunction.
- 4. Do not use pressure sensors with corrosive and/or flammable gases or liquids.

#### Connection

#### **⚠** Caution

- Incorrect wiring can damage the switch and cause a malfunction or erroneous switch output.
- 2. Connections should be done while the power is turned off.
- Wire separately from power lines and high voltage lines, avoiding wiring in the same conduit with these lines. Malfunctions may occur due to noise from these other lines.
- 4. If a commercial switching regulator is used, make sure that the F.G. terminal is grounded.

#### **Operating Environment**


#### **⚠** Warning

- 1. This pressure switch is CE marked; however, it is not equipped with surge protection against lightning. Lightning surge countermeasures should be applied directly to system components as necessary.
- This pressure switch does not have an explosion proof rating. Never use in the presence of an explosive gas as this may cause a serious explosion.

#### **Operating Environment**

#### **⚠** Caution

- 1. Do not use the product in a place where it could be splashed by oils or solvents.
- 2. When this pressure switch is used in a place where water and dust splash on, water and dust may enter inside the switch through the atmospheric vent port. Insert a Ø4 tube (I.D. Ø2.5) into the atmospheric vent port, and bring piping of the opposite side up to the safe position to keep it from water and dust. Do not bend the tube or close the hole of it. It causes malfunction with the measurement of positive pressure.



- \* Make sure that the tube is inserted to the end of the atmospheric vent port.
- \* Use SMC tubing, TU0425. (Material: Polyurethane, Tube O.D. ø4, I.D. ø2.5)
- 3. Take measures against static electricity with equipment when this switch is used in connection with resin piping. Also, the ground should be separate from that of the units that generate strong electromagnetic noise or high frequency, otherwise, the switch can be damaged by static electricity.




## Series ZSE40A(F)/ISE40A Specific Product Precautions 2

Be sure to read before handling.

Refer to back pages 1 and 2 for Safety Instructions, "Handling Precautions for SMC Products" (M-E03-3) for Pressure Switches Precautions.


#### Mounting

#### **⚠** Caution

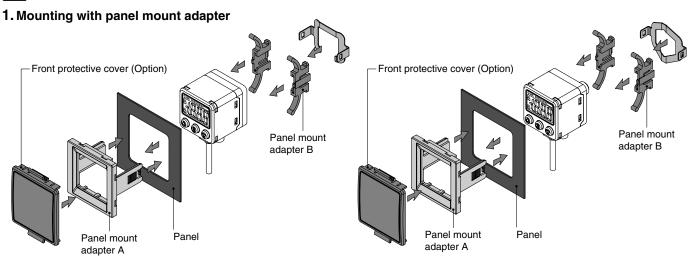

#### 2. Mounting with bracket

Mount a bracket to the using two mounting screws and install on piping. The switch can be installed horizontally depending on the installation location.

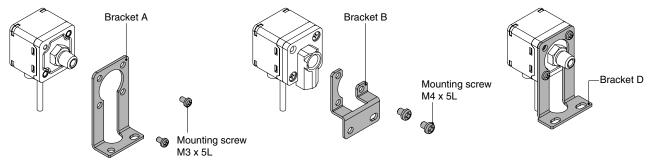

The tightening torque for bracket mounting screw should be 0.5 to 0.7 N·m for M3 and 1.4 to 1.6 N·m for M4.

#### **Set Pressure Range and Rated Pressure Range**


#### **⚠** Caution

#### Set the pressure within the rated pressure range.

The set pressure range is the range of pressure that is possible in setting.

The rated pressure range is the range of pressure that satisfies the specifications (accuracy, linearity, etc.) on the switch.

Although it is possible to set a value outside the rated pressure range, the specifications will not be guaranteed even if the value stays within the set pressure range.

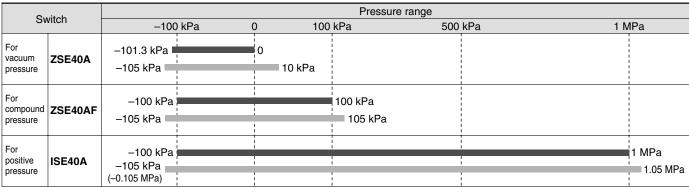

## Related Equipment

#### 2-Colour Display High Precision Digital Pressure Switch ZSE/ISE30A



Series	Туре	Rated pressure range	
ZSE30AF	Compound pressure	–100.0 to 100.0 kPa	
ZSE30A	Low pressure/vacuum	0.0 to −101.0 kPa	
ISE30A	Positive pressure	0.100 to 1.000 MPa	
Features	mounting  • With display calibration	e of vertical and horizontal contact	

#### 2-Colour Display Digital Pressure Switch ZSE/ISE80



Series	Туре	Rated pressure range		
ZSE80F Compound pressure		-100.0 to 100.0 kPa		
ZSE80 Vacuum pressure		-101.0 to 0.0 kPa		
ISE80	Positive pressure	-0.100 to 1.000 MPa		
ISE80H	Positive pressure	-0.100 to 2.000 MPa		
Features	• IP65 • RoHS compliant	,		

Note) VCR® and Swagelok® are trademarks of Swagelok Company.









#### **EUROPEAN SUBSIDIARIES:**



#### Austria

SMC Pneumatik GmbH (Austria). Girakstrasse 8, A-2100 Korneuburg Phone: +43 2262-622800. Fax: +43 2262-62285 E-mail: office@smc.at http://www.smc.at



#### Belgium

SMC Pneumatics N.V./S.A. Nijverheidsstraat 20, B-2160 Wommelgem Phone: +32 (0)3-355-1464, Fax: +32 (0)3-355-1466 E-mail: info@smcpneumatics.be http://www.smcpneumatics.be



#### Bulgaria

SMC Industrial Automation Bulgaria EOOD Business Park Sofia, Building 8 - 6th floor, BG-1715 Sofia Phone:+359 2 9744492, Fax:+359 2 9744519 E-mail: office@smc.bg http://www.smc.bg



#### Croatia

SMC Industrijska automatika d.o.o. Crnomerec 12, HR-10000 ZAGREB Phone: +385 1 377 66 74, Fax: +385 1 377 66 74 E-mail: office@smc.hr http://www.smc.hr



#### Czech Republic

SMC Industrial Automation CZ s.r.o. Hudcova 78a, CZ-61200 Brno Phone: +420 5 414 24611, Fax: +420 5 412 18034 E-mail: office@smc.cz http://www.smc.cz



#### Denmark

SMC Pneumatik A/S Egeskovvej 1, DK-8700 Horsens Phone: +45 70252900, Fax: +45 70252901 E-mail: smc@smcdk.com http://www.smcdk.com



#### Estonia

SMC Pneumatics Estonia OÜ Laki 12, 106 21 Tallinn Phone: +372 6510370, Fax: +372 65110371 E-mail: smc@smcpneumatics.ee http://www.smcpneumatics.ee



#### Finland

SMC Pneumatics Finland Oy PL72, Tiistinniityntie 4, SF-02231 ESPOO Phone: +358 207 513513, Fax: +358 207 513595 E-mail: smcfi@smc.fi http://www.smc.fi



#### France

SMC Pneumatique, S.A.

1, Boulevard de Strasbourg, Parc Gustave Eiffel
Bussy Saint Georges F-77607 Mame La Vallee Cedex 3
Phone: +33 (0)1-6476 1000, Fax: +33 (0)1-6476 1010
E-mail: contact@smc-france.fr http://www.smc-france.fr



#### Germany

SMC Pneumatik GmbH Boschring 13-15, D-63329 Egelsbach Phone: +49 (0)6103-4020, Fax: +49 (0)6103-402139 E-mail: info@smc-pneumatik.de http://www.smc-pneumatik.de



#### Greece

SMC Hellas EPE Anagenniseos 7-9 - P.C. 14342. N. Philadelphia, Athens Phone: +30-210-2717265, Fax: +30-210-2717766 E-mail: sales@smchellas.gr http://www.smchellas.gr



#### Hungary

SMC Hungary Ipari Automatizálási Kft. Torbágy út 19, H-2045 Törökbálint Phone: +36 23 511 390, Fax: +36 23 511 391 E-mail: office@smc.hu http://www.smc.hu



#### Ireland

SMC Pneumatics (Ireland) Ltd. 2002 Citywest Business Campus, Naas Road, Saggart, Co. Dublin Phone: +353 (0)1-403 9000, Fax: +353 (0)1-464-0500 E-mail: sales@smcpneumatics.ie http://www.smcpneumatics.ie



#### Italy

SMC Italia S.p.A Via Garibaldi 62, I-20061 Carugate, (Milano) Phone: +39 (0)2-92711, Fax: +39 (0)2-9271365 E-mail: mailbox@smcitalia.it http://www.smcitalia.it



#### Latvia

SMC Pneumatics Latvia SIA Dzelzavas str. 120g, Riga LV-1021, LATVIA Phone: +371 67817700, Fax: +371 67817701 E-mail: info@smclv.lv http://www.smclv.lv



#### Lithuania

SMC Pneumatics Lietuva, UAB Oslo g.1, LT-04123 Vilnius Phone: +370 5 2308118, Fax: +370 5 2648126 E-mail: info@smclt.lt

http://www.smclt.lt



#### Netherlands

SMC Pneumatics BV SMC Pneumatics BV De Ruyterkade 120, NL-1011 AB Amsterdam Phone: +31 (0)20-5318888, Fax: +31 (0)20-5318880 E-mail: info@smcpneumatics.nl http://www.smcpneumatics.nl Spain

E-mail: post@smc.smces.es http://www.smc.eu

Sweden

Switzerland

Turkey

http://www.smcpneumatics.co.uk

E-mail: smc@entek.com.tr

http://www.entek.com.tr

Ekhagsvägen 29-31, S-141 71 Huddinge Phone: +46 (0)8-603 12 00, Fax: +46 (0)8-603 12 90 E-mail: post@smcpneumatics.se

SMC Pneumatik AG Dorfstrasse 7, CH-8484 Weisslingen Phone: +41 (0)52-396-3131, Fax: +41 (0)52-396-3191 E-mail: info@smc.ch

Entek Pnömatik San. ve Tic. A\*. Perpa Ticaret Merkezi B Blok Kat: 11 No: 1625, TR-34386, Okmeydani, Islanbul Phone: +90 (0)212-444-0762, Fax: +90 (0)212-221-1519

SMC Pneumatics (UK) Ltd Vincent Avenue, Crownhill, Milton Keynes, MK8 0AN Phone: +44 (0)845 121 5122 Fax: +44 (0)1908-555064 E-mail: sales@smcpneumatics.co.uk

SMC Pneumatics Sweden AB

http://www.smc.nu

http://www.smc.ch

SMC España, S.A. Zuazobidea 14, 01015 Vitoria Phone: +34 945-184 100, Fax: +34 945-184 124



#### Norway

SMC Pneumatics Norway A/S Vollsveien 13 C, Granfos Næringspark N-1366 Lysaker Tel: +47 67 12 90 20, Fax: +47 67 12 90 21 E-mail: post@smc-norge.no http://www.smc-norge.no



#### Poland

SMC Industrial Automation Polska Sp.z.o.o. ul. Poloneza 89, PL-02-826 Warszawa, Phone: +48 22 211 9600, Fax: +48 22 211 9617 E-mail: office@smc.pl http://www.smc.pl



Portugal SMC Sucursal Portugal, S.A. Rua de Engº Ferreira Dias 452, 4100-246 Porto Phone: +351 226 166 570, Fax: +351 226 166 589 E-mail: postpt@smc.smces.es http://www.smc.eu



#### Romania

SMC Romania srl Str Frunzei 29, Sector 2, Bucharest Phone: +40 213205111, Fax: +40 213261489 E-mail: smcromania@smcromania.ro http://www.smcromania.ro



#### Russia

SMC Pneumatik LLC. AB Sverdlovskaja nab, St. Petersburg 195009 Phone::-7 812 718 5445, Fax:+7 812 718 5449 E-mail: info@smc-pneumatik.ru http://www.smc-pneumatik.ru



#### Slovakia

SIOVAKIA SMC Priemyselná Automatizáciá, s.r.o. Fatranská 1223, 01301 Teplicka Nad Váhom Phone: +421 41 3213212 - 6 Fax: +421 41 3213210 E-mail: office@smc.sk http://www.smc.sk



#### Slovenia

SMC industrijska Avtomatika d.o.o. Mirnska cesta 7, SI-8210 Trebnje Phone: +386 7 3885412 Fax: +386 7 3885435 E-mail: office@smc.si http://www.smc.si





#### OTHER SUBSIDIARIES WORLDWIDE:

ARGENTINA, AUSTRALIA, BOLIVIA, BRASIL, CANADA, CHILE, CHINA, HONG KONG, INDIA, INDONESIA, MALAYSIA, MEXICO, NEW ZEALAND, PHILIPPINES, SINGAPORE, SOUTH KOREA, TAIWAN, THAILAND, USA, VENEZUELA

> http://www.smc.eu http://www.smcworld.com

